

Dumfries & Galloway Strategic Reinforcement SER

Project Design Requirements

Substation Location

- Existing Substation
- New Substation Location to be confirmed

Existing Transmission Network

- 132KV Overhead Line
- 275KV Overhead Line
- 400KV Overhead Line
- 400/275KV Overhead Line

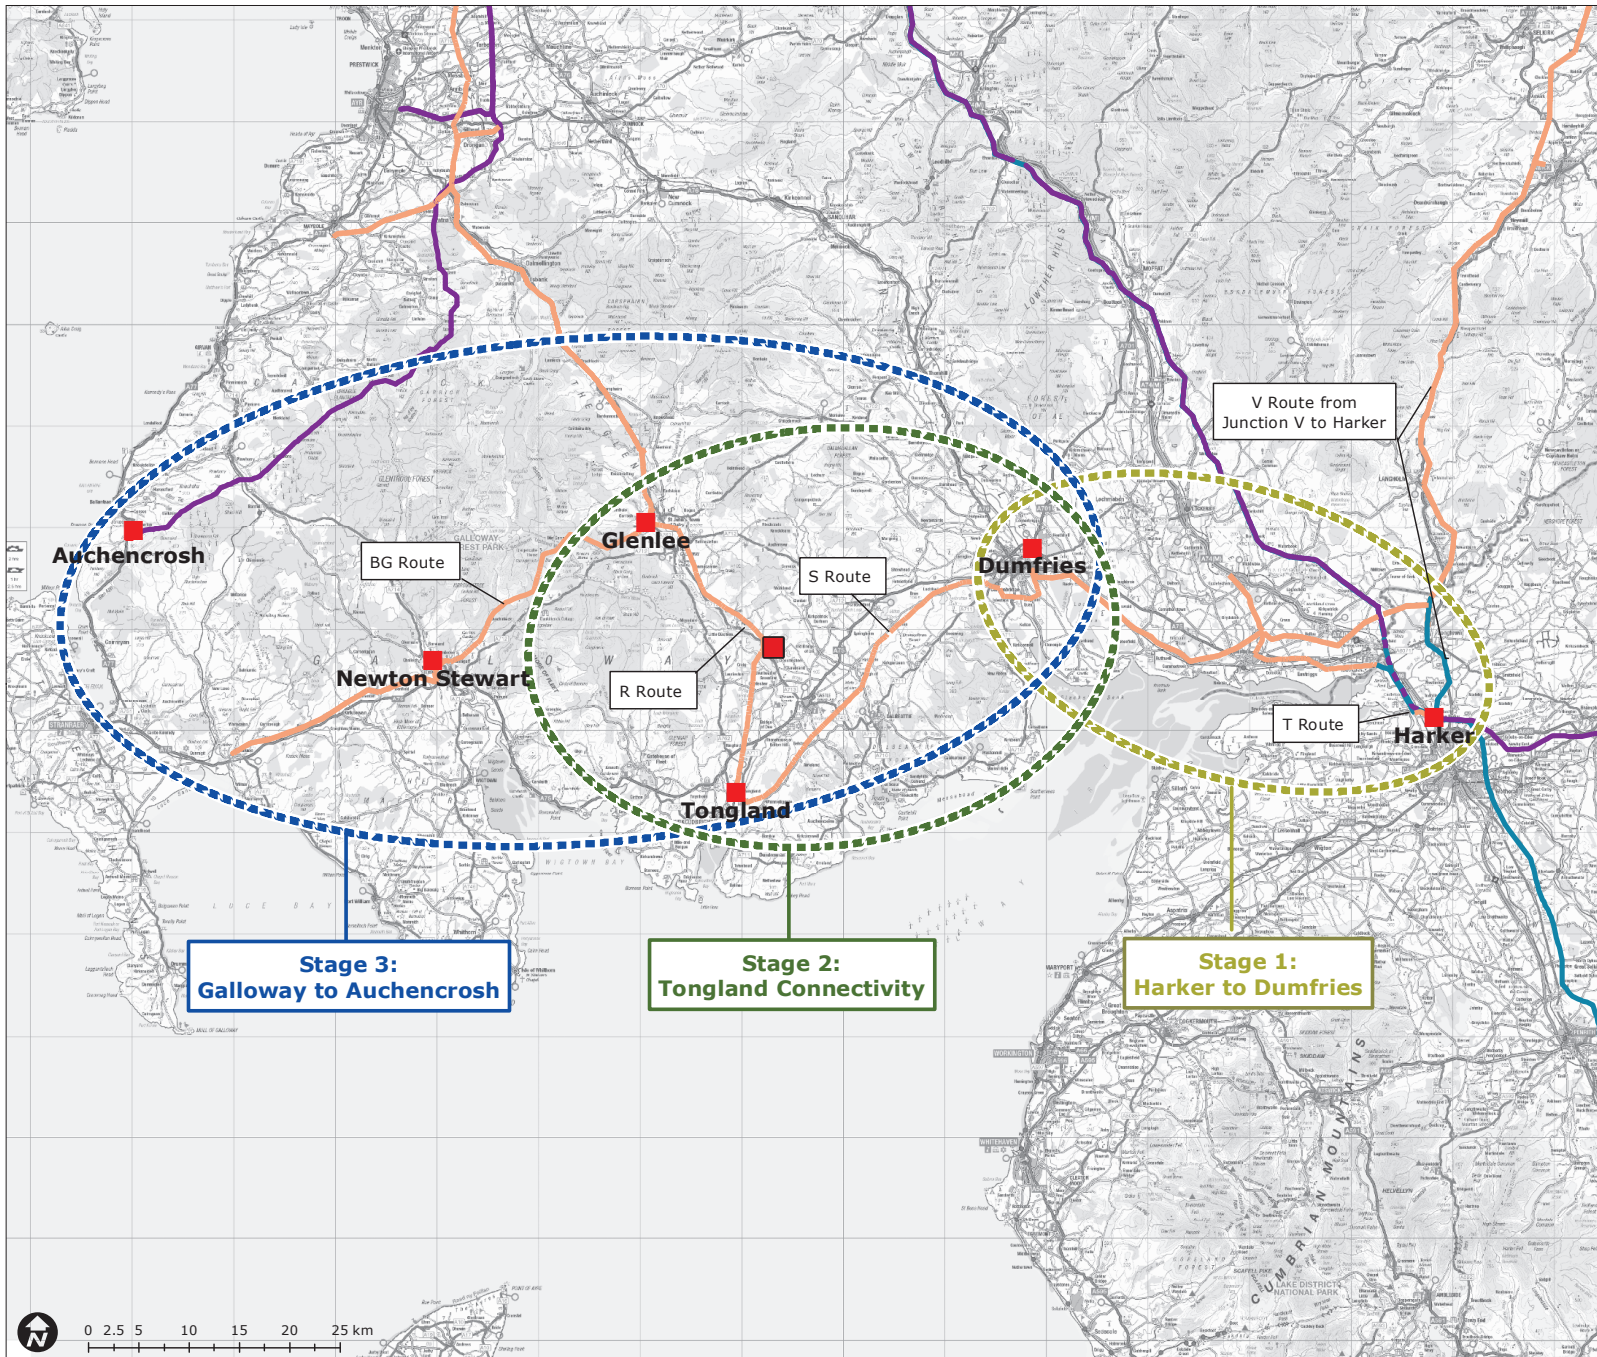


Figure 2.1

Map Scale @ A3:1:500,000

